

Thermal modeling of buildings: Part 1

Purdue ME 597, Distributed Energy Resources

Kevin J. Kircher


Outline

Background

First-order thermal circuits


Thermal circuit model parameters

Buildings dominate US electricity use

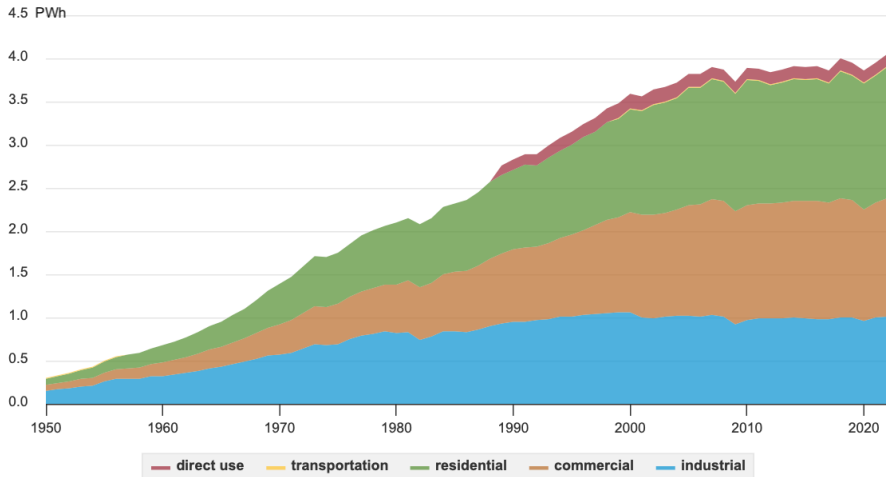


Energy Information Administration: [Use of electricity](#)

HVAC&R dominates building energy and electricity use

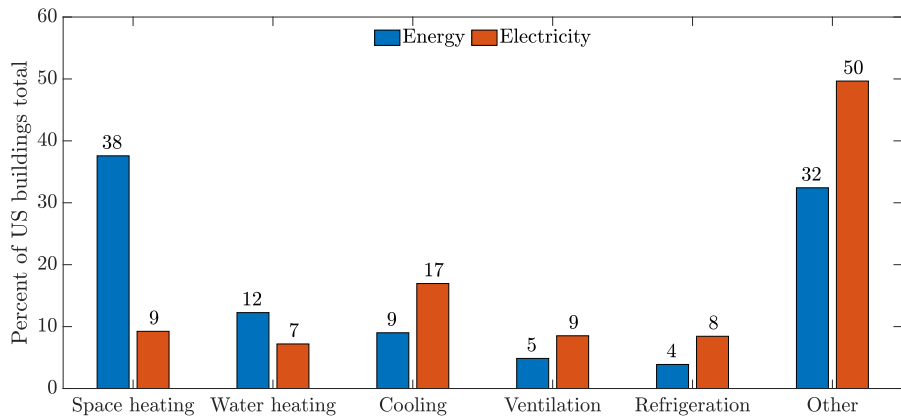

Detailed thermal modeling is hard

$$\frac{\partial T}{\partial t} = \alpha \left(\frac{\partial^2 T}{\partial x^2} + \frac{\partial^2 T}{\partial y^2} + \frac{\partial^2 T}{\partial z^2} \right) + \dots$$

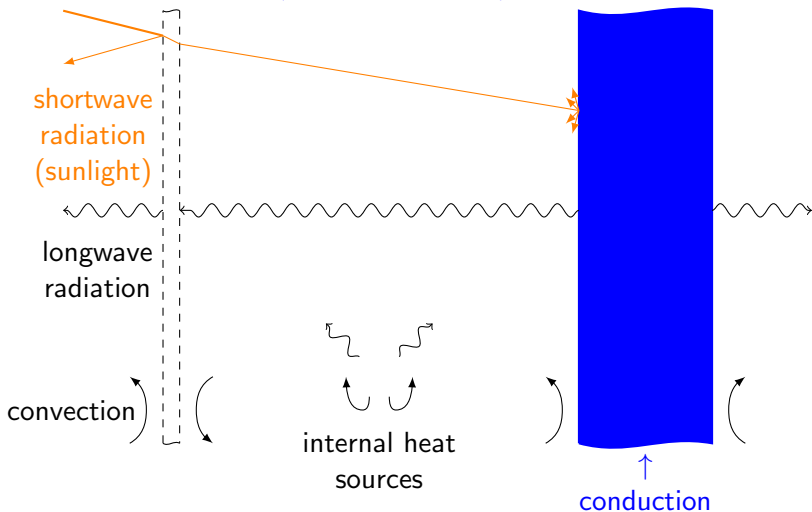

- EnergyPlus (US DOE, open source)
- TRNSYS (**T**ransient **S**ystem **S**imulation, commercial)
- Modelica buildings library (US DOE, open source)
- these programs are broad and powerful, but can
 - ◇ require many parameters, some hard to specify or fit
 - ◇ be slow (numerical solution of coupled nonlinear PDEs)
 - ◇ be difficult to integrate with other software
- our focus: simpler models for DER design and control

Outline

Background


First-order thermal circuits

Thermal circuit model parameters

Thermal circuit models capture dominant physics


- thermal circuits work by analogy to electrical circuits
 - ◇ temperature \leftrightarrow voltage
 - ◇ heat \leftrightarrow charge
 - ◇ thermal resistance \leftrightarrow electrical resistance
 - ◇ thermal capacitance \leftrightarrow electrical capacitance
- basic idea: temperature differences drive heat flow
(like voltage differences drive charge flow [current])

Simplest thermal circuit: 1R1C

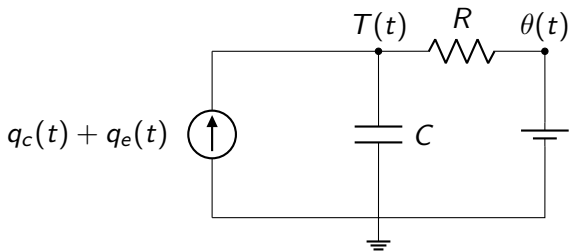

- $T(t)$ ($^{\circ}\text{C}$) is indoor temperature
- $\theta(t)$ ($^{\circ}\text{C}$) is boundary (often outdoor air) temperature
- R ($^{\circ}\text{C}/\text{kW}$) is thermal resistance between T and θ
- C ($\text{kWh}/^{\circ}\text{C}$) is indoor thermal capacitance
- $q_c(t)$ (kW) is thermal power from controlled equipment
- $q_e(t)$ (kW) is thermal power from exogenous sources (sunlight, body heat, plug loads, ...)

1R1C continuous-time dynamics

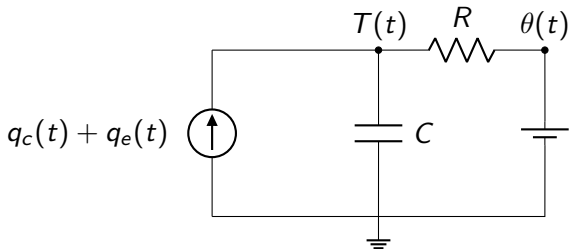

- Ohm's law: current through resistor is $(T(t) - \theta(t))/R$
- rate of charge accumulation on capacitor is $CdT(t)/dt$
- Kirchhoff's Current Law (KCL) at node labeled $T(t)$:

current inflow = current outflow

$$q_c(t) + q_e(t) = \frac{T(t) - \theta(t)}{R} + C \frac{dT(t)}{dt}$$

1R1C discrete-time dynamics

- rearranging continuous-time dynamics gives

$$\frac{dT(t)}{dt} = \frac{1}{RC} [-T(t) + \theta(t) + R(q_c(t) + q_e(t))],$$


a first-order linear ODE

- with uniform time step Δt and piecewise constant θ , q_c , q_e ,

$$T(k+1) = aT(k) + (1-a)R(q_c(k) + w(k))$$

where $a = e^{-\Delta t/(RC)}$ and $w(k) = q_e(k) + \theta(k)/R$

A 2R1C thermal circuit

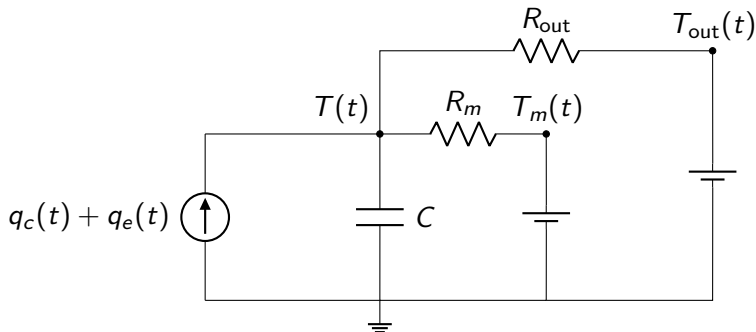

- $T_m(t)$ ($^{\circ}\text{C}$) is thermal mass temperature
- $T_{\text{out}}(t)$ ($^{\circ}\text{C}$) is outdoor air temperature
- R_m ($^{\circ}\text{C}/\text{kW}$) is thermal resistance between T and T_m
- R_{out} ($^{\circ}\text{C}/\text{kW}$) is thermal resistance between T and T_{out}

Reducing a 2R1C thermal circuit to 1R1C

- KCL at node labeled $T(t)$ gives 2R1C dynamics:

$$C \frac{dT(t)}{dt} = \frac{T_m(t) - T(t)}{R_m} + \frac{T_{\text{out}}(t) - T(t)}{R_{\text{out}}} + q_c(t) + q_e(t)$$


- a bit of algebra shows this is equivalent to the 1R1C model

$$C \frac{dT(t)}{dt} = \frac{\theta(t) - T(t)}{R} + q_c(t) + q_e(t)$$

with

$$R = \frac{R_m R_{\text{out}}}{R_m + R_{\text{out}}}$$
$$\theta(t) = \frac{R_{\text{out}} T_m(t) + R_m T_{\text{out}}(t)}{R_m + R_{\text{out}}}$$

An $nR1C$ thermal circuit

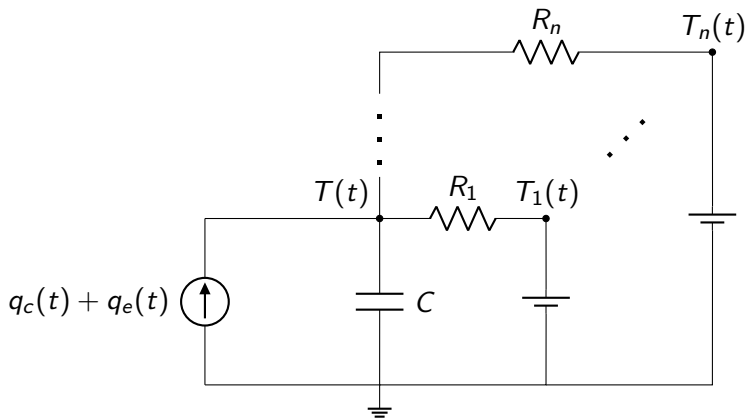

$$\text{KCL} \implies C \frac{dT(t)}{dt} = \sum_{i=1}^n \frac{T_i(t) - T(t)}{R_i} + q_c(t) + q_e(t)$$

Reducing an n R1C thermal circuit to 1R1C

can show that the n R1C model is equivalent to the 1R1C model

$$C \frac{dT(t)}{dt} = \frac{\theta(t) - T(t)}{R} + q_c(t) + q_e(t)$$

with

$$R = \frac{R_1 \cdots R_n}{R_2 \cdots R_n + \cdots + R_1 \cdots R_{n-1}}$$
$$\theta(t) = \frac{R_2 \cdots R_n T_1(t) + \cdots + R_1 \cdots R_{n-1} T_n(t)}{R_2 \cdots R_n + \cdots + R_1 \cdots R_{n-1}}$$

Outline

Background

First-order thermal circuits

Thermal circuit model parameters

Thermal circuit parameters

thermal circuit models have three types of parameter:

1. thermal capacitance $C > 0$ (kWh/°C)
2. thermal resistance $R > 0$ (°C/kW)
3. exogenous thermal power $q_e(t)$ (kW, a time series)

Typical thermal capacitance values

- can model thermal capacitance as $C = \rho c_p V$, where
 - ◇ $\rho = 1.293 \text{ kg/m}^3$
 - ◇ $c_p = 2.792 \times 10^{-4} \text{ kWh}/(\text{kg } ^\circ\text{C})$
 - ◇ $V = A_f h$ is enclosed volume
(A_f is total floor area on all stories; h is height of one story)
- this models air at standard temperature and pressure
- often, 'shallow' thermal mass couples tightly to indoor air

$$\begin{aligned}\implies C &\approx (10 \text{ to } 15) \rho c_p A_f h \\ &= (0.0036 \text{ to } 0.0054 \text{ kWh}/[^\circ\text{Cm}^3]) A_f h\end{aligned}$$

- example: for a $\sim 200 \text{ m}^2$ house with ceiling heights of $\sim 3 \text{ m}$,

$$C \approx 2.2 \text{ to } 3.2 \text{ kWh}/^\circ\text{C}$$

Thermal resistance from weather and energy data

- if $T(t) \approx \hat{T}$ and $q_e(t) \approx \hat{q}_e$ are \sim constant over some period, then

$$C \frac{dT(t)}{dt} \overset{\sim 0}{\approx} \frac{\theta(t) - \hat{T}}{R} + q_c(t) + \hat{q}_e \implies q_c(t) \approx \frac{\hat{T} - \theta(t)}{R} - \hat{q}_e$$

- suppose we guess a δ ($^{\circ}\text{C}$) such that if $\hat{T} - \theta(t) \approx \delta$, then $q_c(t) \approx 0$
- this gives an estimate of \hat{q}_e :

$$\hat{T} - \theta(t) \approx \delta \implies q_c(t) \approx \frac{\delta}{R} - \hat{q}_e \approx 0 \implies \hat{q}_e \approx \frac{\delta}{R}$$

- it also gives a simplified expression for $q_c(t)$:

$$q_c(t) \approx \frac{\hat{T} - \delta - \theta(t)}{R} = \frac{\theta_h - \theta(t)}{R}$$

- $\theta_h = \hat{T} - \delta$ is the **heating balance outdoor temperature**

R from weather and energy data (continued)

- define the cumulative heat demand $H = \int \max \{0, q_c(t)\} dt$
- with $q_c(t) \approx \frac{\theta_h - \theta(t)}{R}$,

$$H \approx \int \max \left\{ 0, \frac{\theta_h - \theta(t)}{R} \right\} dt = \frac{\Theta_h}{R}$$

- Θ_h ($^{\circ}\text{Ch}$) is the number of heating degree-hours at HBOT θ_h :

$$\Theta_h = \int \max \{0, \theta_h - \theta(t)\} dt$$


- with heater efficiency η , the heater input energy is $E = H/\eta$ and

$$R \approx \frac{\Theta_h}{\eta E}$$

Heating and cooling degree-days

$$\text{HDD}(\theta_h) = \left(\frac{1 \text{ day}}{24 \text{ h}} \right) \int \max \{0, \theta_h - \theta(t)\} dt = \left(\frac{1 \text{ day}}{24 \text{ h}} \right) \Theta_h$$

$$\text{CDD}(\theta_c) = \left(\frac{1 \text{ day}}{24 \text{ h}} \right) \int \max \{0, \theta(t) - \theta_c\} dt = \left(\frac{1 \text{ day}}{24 \text{ h}} \right) \Theta_c$$

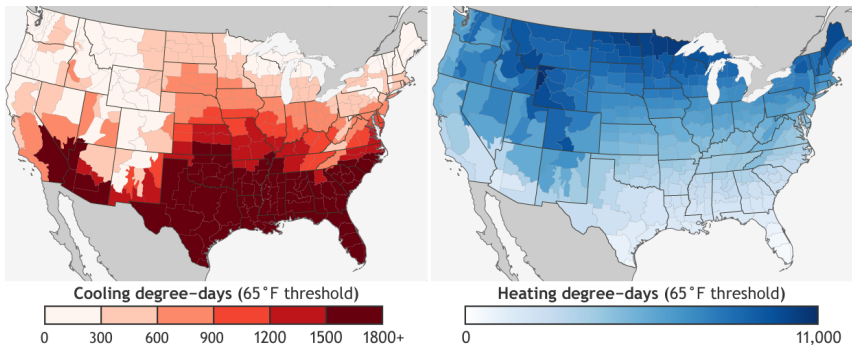


Summary: R from weather and energy data

1. get typical heating temperature setpoint \hat{T}
2. estimate indoor-outdoor temperature difference δ where $q_c \approx 0$ (typically 6 to 10 °C for badly- to well-insulated detached houses)
3. define heating balance outdoor temperature $\theta_h = \hat{T} - \delta$
4. get historical HDD(θ_h) (°C·day) over a heating period
5. get historical heater input energy E (kWh) over the same period
6. estimate heater efficiency η
7. set

$$R \approx \left(\frac{24 \text{ h}}{1 \text{ day}} \right) \frac{\text{HDD}(\theta_h)}{\eta E}$$

- ★ can find benchmark E data in RECS and CBECS
- ★ bonus: time-average of $q_e(t)$ should be $\sim \delta/R$

Thermal resistance from first principles

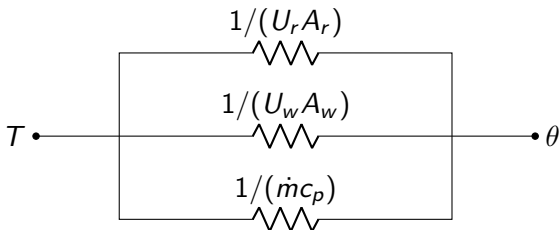

- can model thermal resistance as $R = 1/(U_r A_r + U_w A_w + \dot{m} c_p)$
- U (kW/[°Cm²]) is thermal transmittance
- A (m²) is outward-facing surface area
- subscript r means roof, w means vertical wall/window assemblies
- \dot{m} (kg/h) is mass flow rate of outdoor air infiltration

A typical wall assembly




Thermal transmittance

- typical thermal transmittances (note units of **W**, not **kW**) are
 - ◇ ~1, 2.5, or 5 **W**/($^{\circ}\text{Cm}^2$) for windows with 3, 2, or 1 pane(s)
 - ◇ ~0.2 to 0.8 **W**/($^{\circ}\text{Cm}^2$) for framed, insulated, opaque walls
 - ◇ ~0.2 to 0.5 **W**/($^{\circ}\text{Cm}^2$) for framed, insulated, opaque roofs
- for a wall assembly whose surface area is $100\lambda\%$ windows,

$$U_w = \lambda U_{\text{window}} + (1 - \lambda) U_{\text{wall}}$$


- a typical wall assembly has $\lambda \approx 0.1$ to 0.3
- ⇒ overall $U_w \approx 0.7$ to 1.3 **W**/($^{\circ}\text{Cm}^2$)

Window-to-wall ratio λ

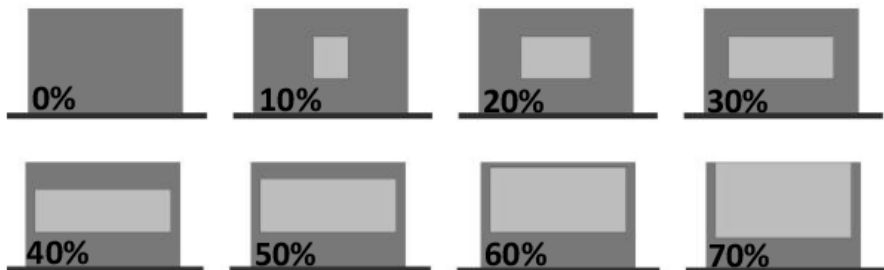

El-Deeb (2013): Combined effect of window-to-wall ratio and wall composition on energy consumption

Wall area

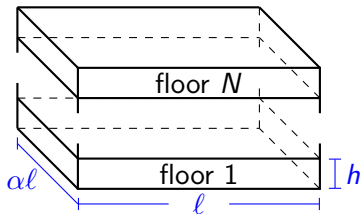

floor aspect ratio: α


total floor area: $A_f = \alpha N l^2$

$$\implies l = \sqrt{A_f / (\alpha N)}$$


total wall area: $A_w = 2(1 + \alpha) N l h$

$$\implies A_w = 2(1 + \alpha) h \sqrt{N A_f / \alpha}$$

- roof area is $A_r = A_f / N$
- $(1 + \alpha) / \sqrt{\alpha} \approx 2$, so $A_w \approx 4h \sqrt{N A_f}$

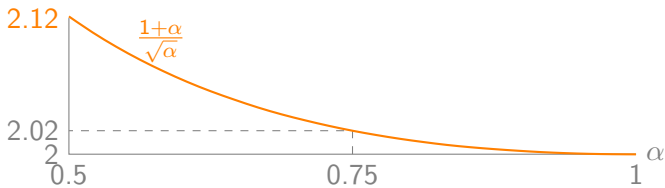

Infiltration of outdoor air



- outdoor air enters through gaps in doors, windows, etc.
- indoor air exits at \sim same mass flow rate \dot{m}
- this mass transfer entails heat transfer at rate $\dot{m}c_p(\theta - T)$
- with ν (1/h) air changes per hour, $\dot{m} = \nu\rho A_f h$
(1 air change = outdoor air fills building's volume $A_f h$ once)
- typically, $\nu \approx 0.3$ to 0.9 per hour

Handley (1973): [Home ventilation rates: A literature study](#), Younes (2011): [Air infiltration through building envelopes: A review](#)

Summary: Thermal resistance from first principles

- with total floor area A_f and N stories, each of height h ,

$$\begin{aligned} 1/R &\approx (2 \text{ to } 5 \times 10^{-4} \text{ kW}/[^\circ\text{Cm}^2])A_f/N \\ &\quad + (2.8 \text{ to } 5.2 \times 10^{-3} \text{ kW}/[^\circ\text{Cm}^2])h\sqrt{NA_f} \\ &\quad + (1.5 \text{ to } 2.9 \times 10^{-4} \text{ kW}/[^\circ\text{Cm}^3])A_f h \end{aligned}$$

- example: for a $\sim 200 \text{ m}^2$ house with 2 stories and $\sim 3 \text{ m}$ ceilings,

$$R \approx 2.5 \text{ } ^\circ\text{C}/\text{kW}$$

Typical exogenous thermal power values

- can decompose $q_e(t)$ into heat transfer from
 1. sun
 2. plugged-in devices (lights, electronics, electric cooking, ...)
 3. other (body heat, fossil-fueled cooking, wood fireplaces, ...)
- #2 may be measured
(typical time-average $\approx 250 \text{ W} + (2.65 \text{ W/m}^2)A_f$)
- #3 is often small (e.g., $\sim 100 \text{ W}$ per body)
- check: from HDD analysis, time-average of $q_e(t)$ should be $\sim \delta/R$

Thermal power from sunlight through windows (#1)

- solar formulas can give solar thermal power through each window
- alternatively, can approximate the total through all windows as

$$q_{\text{sun}}(t) \approx \left(1.5 \text{ to } 1.7 \sqrt{\text{kW/m}} \right) c \lambda h \sqrt{NA_f S_{\text{tot}}^-(t)}$$

- $S_{\text{tot}}^-(t)$ (kW/m^2) is the total solar irradiance on a horizontal surface
- $c \in [0, 1]$ (typically 0.25 to 0.8) is the **solar heat gain coefficient** (the fraction of incident solar irradiance that a window transmits)
- ★ can simulate shading from blinds, trees, etc. by reducing c